



SUBSTITUTION REQUEST

(After the Bidding/Negotiating Phase)

Project: _____ Substitution Request Number: _____

From: _____
To: _____ Date: _____

A/E Project Number: _____
Re: _____ Contract For: _____

Specification Title: _____ Description: _____
Section: _____ Page: _____ Article/Paragraph: _____

Proposed Substitution: _____
Manufacturer: _____ Phone: _____
Address: _____
Trade Name: _____ Model No.: _____
Installer: _____ Phone: _____
Address: _____

History: ☐ New product ☐ 1-4 years old ☐ 5-10 years old ☐ More than 10 years old

Differences between proposed substitution and specified product: _____

☐ Point-by-point comparative data attached — REQUIRED BY A/E

Reason for not providing specified item: _____

Similar Installation:

Project: _____ Architect: _____
Address: _____ Owner: _____
_____ Date Installed: _____

Proposed substitution affects other parts of Work: ☐ No ☐ Yes; explain _____

Savings to Owner for accepting substitution: _____ (\$ _____).

Proposed substitution changes Contract Time: ☐ No ☐ Yes [Add] [Deduct] _____ days.

Supporting Data Attached: ☐ Drawings ☐ Product Data ☐ Samples ☐ Tests ☐ Reports ☐ _____

SUBSTITUTION REQUEST

(After the Bidding/Negotiating Phase — Continued)

The Undersigned certifies:

- Proposed substitution has been fully investigated and determined to be equal or superior in all respects to specified product.
- Same warranty will be furnished for proposed substitution as for specified product.
- Same maintenance service and source of replacement parts, as applicable, is available.
- Proposed substitution will have no adverse effect on other trades and will not affect or delay progress schedule.
- Cost data as stated above is complete. Claims for additional costs related to accepted substitution which may subsequently become apparent are to be waived.
- Proposed substitution does not affect dimensions and functional clearances.
- Payment will be made for changes to building design, including A/E design, detailing, and construction costs caused by the substitution.
- Coordination, installation, and changes in the Work as necessary for accepted substitution will be complete in all respects.

Submitted by: _____

Signed by: _____

Firm: _____

Address: _____

Telephone: _____

Attachments: ☐

A/E's REVIEW AND ACTION

- ☐ Substitution approved - Make submittals in accordance with Specification Section 01 25 00 Substitution Procedures.
- ☐ Substitution approved as noted - Make submittals in accordance with Specification Section 01 25 00 Substitution Procedures.
- ☐ Substitution rejected - Use specified materials.
- ☐ Substitution Request received too late - Use specified materials.

Signed by: _____ Date: _____

Additional Comments: ☐ Contractor ☐ Subcontractor ☐ Supplier ☐ Manufacturer ☐ A/E
☐ Other:

ESFP-Series Installation Instructions

ARCHITECTURAL SEISMIC SYSTEM

MODEL(S): ESFP/ESFPw

ESFP Floor to Floor Cover System



GENERAL DESCRIPTION

The ESFP Architectural Blockout/No Bump Seismic System is designed to cover expansion control openings in structural, high-movement floor joints, when standard aluminum is acceptable. The ESFP provides a no bump transition.

GENERAL SAFETY PRECAUTIONS Improper selection, installation, or use can cause personal injury or property damage. It is solely the responsibility of the user, through their own analysis, to select products suitable to the specific application requirements, ensure proper maintenance and use as intended. Follow local, state, and federal regulations for proper installation and operation requirements.

Introduction + Safety

Please read the complete instructions carefully before beginning any work. To ensure proper installation and performance of the product, the following actions must be completed by the installing contractor. Failure to do so will affect product warranty.

Transportation + Storage

- Inspect all shipments and materials for missing or damaged components and hardware.
- Material must be stored in a clean, dry location.

Preparation

- Locate the packing slip(s) and/or shop drawings.
- Verify that all products listed on the packing slip included in the package.
- Check the products for damage. If products are damaged, report a freight claim immediately and leave the products in their packaging. If you sign for products without reporting damage, you waive your right to a freight claim and will be responsible for replacement costs.
- Read the instructions thoroughly before beginning installation.



Tool List

- Tape measure
- Phillips
- Hex screwdriver
- Slotted Drivers for Anchors
- Levels
- Awls
- Masking tape
- Rubber mallet
- Wooden block
- Trowel
- Chop saw to cut product to length
- Electric drill with 5/32" masonry bit
- Broom & dustpan or vacuum

Included with the expansion joint system:

3/16" X 1-3/4" Tapcon fastener

Preinstallation

1. Pour floors with blockouts as shown on shop drawings. The blockout should be a minimum of 2" wider than the exposed cover width by the specified depth.
2. Ensure that the blockout is smooth. High spots should be ground down and low spots filled in. Make sure the blockout is clean by sweeping and/or vacuuming.

INSTALLATION

1. Remove the factory installed #10-24 screw that attaches the wing plate to the base member frame and retain for reinstallation later. *Note: In the 2", 4" and 6" sizes this step is not necessary as the wing plate and frame are one piece.* **See Figure 1**



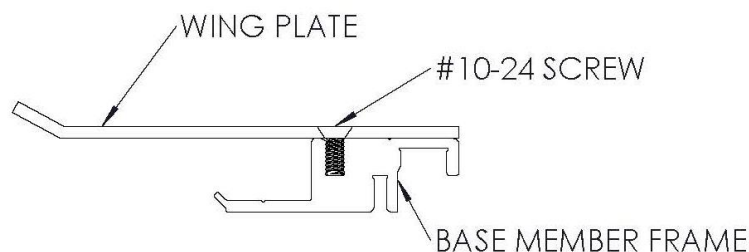


FIGURE 1

2. Position base member frames in blockout per shop drawings. Using the frame as a template mark, drill 5/32" holes for Tapcon fasteners. Install base member frames to the blockout opening with fasteners, making sure not to over tighten. **See Figure 2**

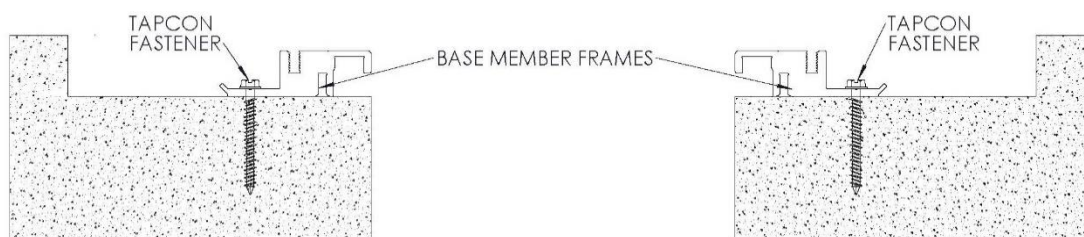


FIGURE 2

3. Reinstall the wing plate to the base member frame with the #10-24 screw. *Note: This step not necessary on the 2", 4" and 6" sizes.* **See Figure 3**

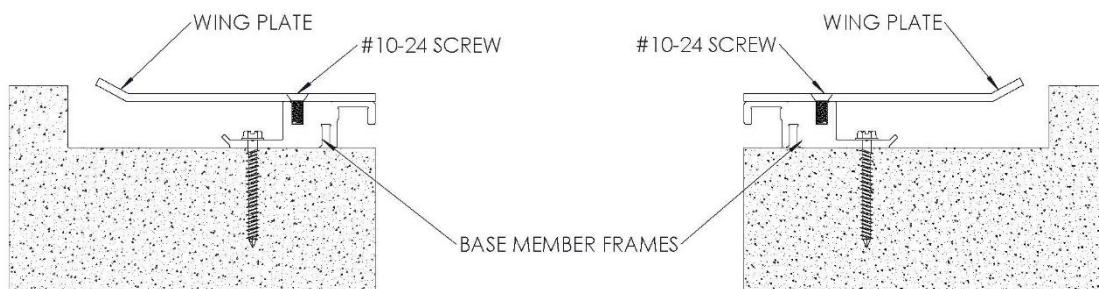


FIGURE 3

4. Protect the exposed surface of the expansion joint, grout in the blockout level with the surrounding floor. **See Figure 4**

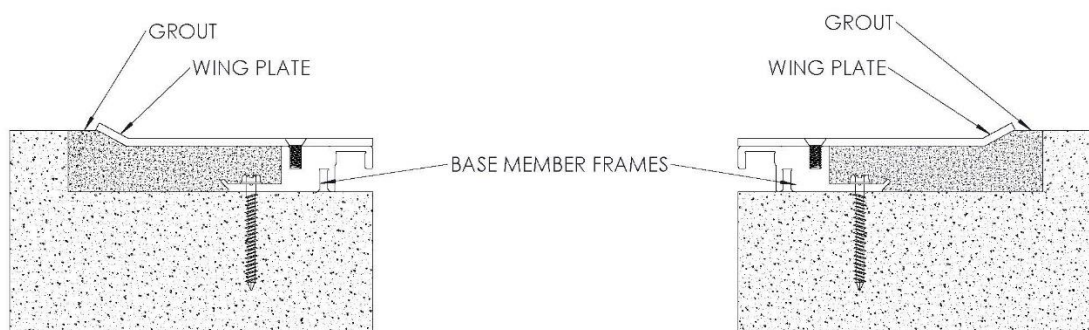


FIGURE 4

5. Finish floor may be installed after grout has cured. **See Figure 5**

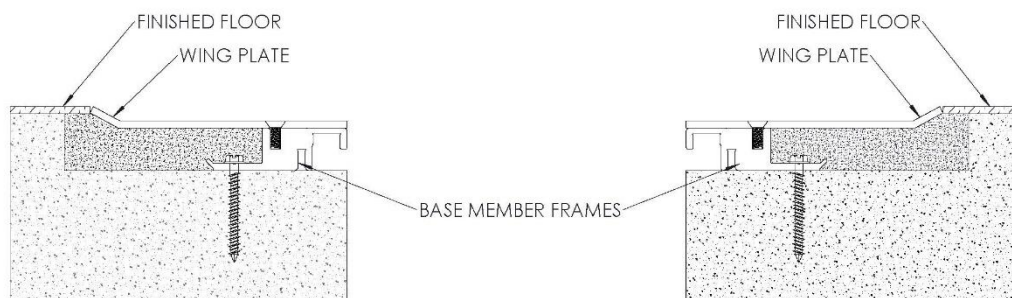


FIGURE 5

6. Lay cover plate over the left base frame with ends flush and mark cover plate center holes onto the base frame near the inside edge. Repeat this on the right side. Position the spring assembly in the spring track on the base frames. This is done by sliding the spring assemblies in from the ends of the frames and aligning them with the marked locations. The spring assemblies will be diagonal to the opening. Tape may be needed to hold the spring assembly in place. **See Figure 6**

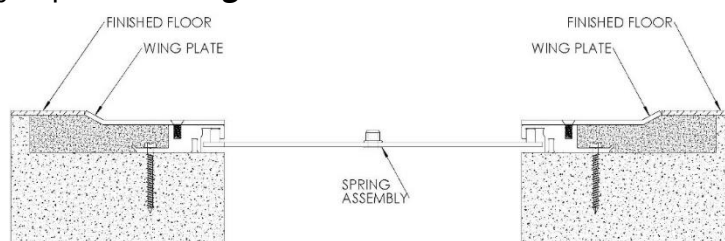


FIGURE 6

7. Position the cover plate centered over the base frame and with the center hole aligned with the spring assemblies. Attach the cover plate to the spring assemblies with the provided spring screws. **DO NOT OVERTIGHTEN. See Figure 7**

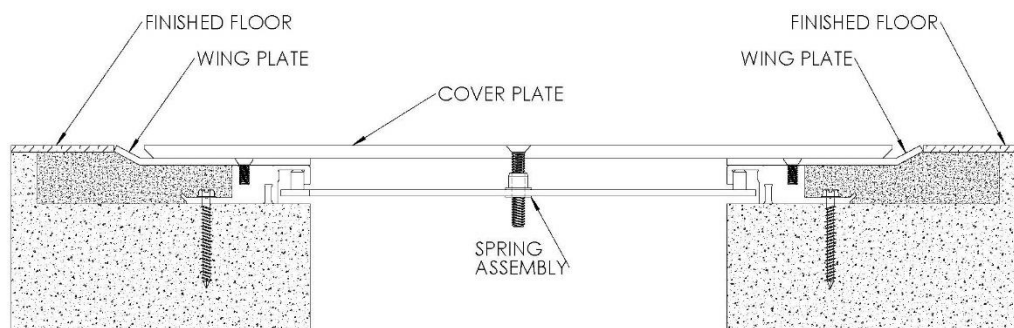


FIGURE 7

ESFPw Floor to Wall Cover System



GENERAL DESCRIPTION

The ESFPw Interior Cover System is designed to match the ESFP cover plate in floor to wall applications.

Tool List

- Tape measure
- Phillips
- Hex screwdriver
- Slotted Drivers for Anchors
- Levels
- Awls
- Masking tape
- Rubber mallet
- Wooden block
- Trowel
- Chop saw to cut product to length
- Electric drill with 5/32" masonry bit
- Broom & dustpan or vacuum

Included with the expansion joint system:

- 3/16" x 1-3/4" Tapcon fastener

Preinstallation

1. Pour floors with blockouts as shown on shop drawings. The blockout should be a minimum of 1" wider than the exposed cover width by the specified depth.
2. Ensure that blockout is smooth. High spots should be ground down and low spots filled in. Make sure blockout is clean by sweeping and/or vacuuming.

INSTALLATION

1. Remove the factory installed #10-24 screw that attaches the wing plate to the base member frame and retain for reinstallation later. *Note: In the 2", 4" and 6" sizes this step is not necessary as the wing plate and frame are one piece.* **See Figure 1**

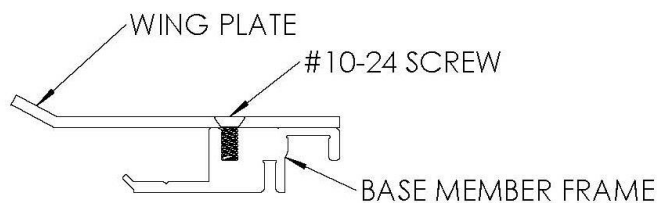


FIGURE 1

2. Position base member frame in blockout per shop drawings. Using the frame as a template, mark and drill 5/32" holes for Tapcon fasteners. Install base member frame to blockout opening with fasteners, making sure not to over tighten. **See Figure 2**


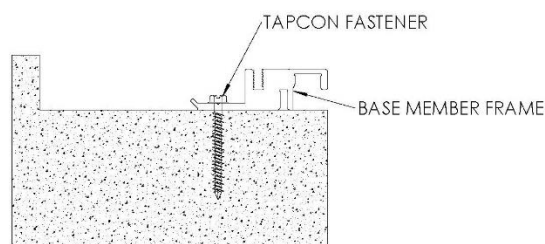


FIGURE 2



3. Reinstall the wing plate to the base member frame with the #10-24 screw. *Note: This step not necessary on the 2", 4" and 6" sizes.* **See Figure 3**

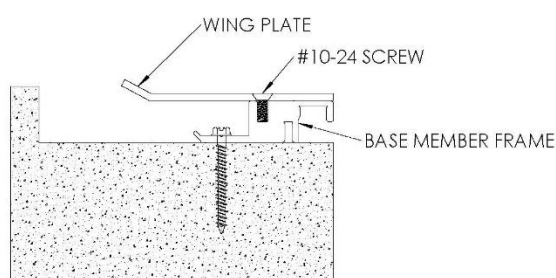


FIGURE 3



4. Protect the exposed surface of the expansion joint, grout in the blockout level with the surrounding floor. **See Figure 4**

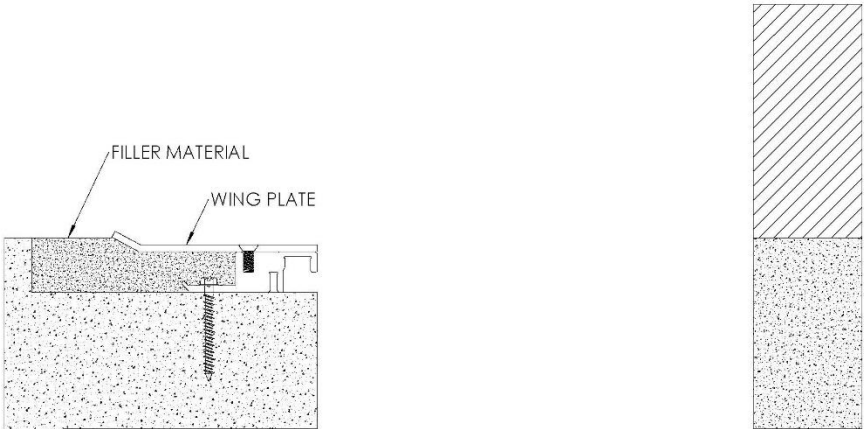


FIGURE 4

5. Finish floor may be installed after grout has cured. **See Figure 5**

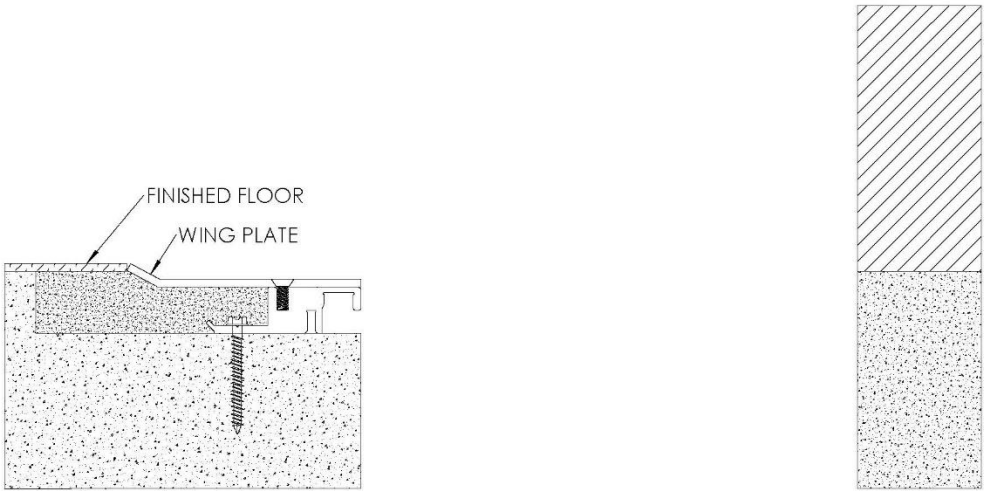


FIGURE 5

6. Position cover plate against wall as shown, making sure the top of its horizontal face is level when set on the wing plate. Attach plate to wall using appropriate 3/16" fasteners for the wall type, 18" o.c. *Note: Wall fasteners are not provided. See Figure 6*

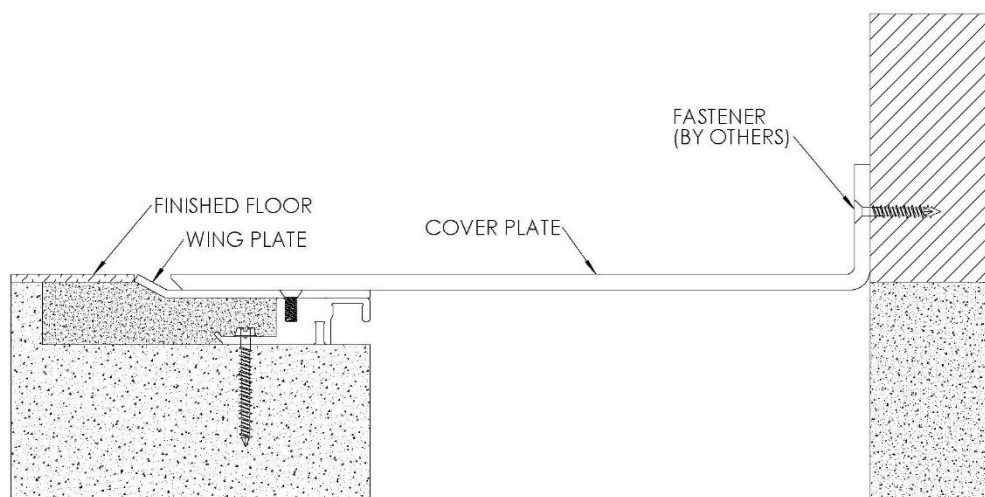


FIGURE 6



Erie Metal Specialties, Inc.
13311 Main Road
Akron, NY 14001
Phone: 716-542-3991
Fax: 716-542-3996
E-mail: sales@eriemetal.com
Web: www.eriemetal.com

SPECIFICATION

Section 07 95 13

Erie Metal Specialties, Interior Architectural Systems

Model(s) “ESFP”, “ESFP-W”

Seismic Floor Expansion System

PART 1 - GENERAL

1.01 Work Included

- A. The work shall consist of furnishing and installing expansion joints in accordance with the details shown on the plans and the requirements of the specifications. The joint designs utilize extruded base members and inverted support plates.
- B. Related Work
 - Cast-in-place concrete
 - Miscellaneous and ornamental metals
 - Flashing and sheet metal
 - Sealants and caulking

1.02 Submittals

- A. CAD Drawings – Illustrating the typical joint cross-section of the seismic floor details. Present necessary dimensions, connections and anchorage methods.

1.03 Product Delivery, Storage and Handling

- A. Deliver products in each manufacturer's original, intact, labeled containers and store under cover in a dry location until installed. Store off the ground, protect from the elements and construction activities.

1.04 Acceptable Manufacturer

- A. All joints shall be supplied by; Erie Metal Specialties, Inc. • 13311 Main Road • Akron • New York • 14001 • Phone (716) 542-3991 • Fax (716) 542-3996 • sales@eriemetal.com • www.eriemetal.com .
- B. Alternate manufacturers and their products will be considered, provided they meet the design concept and are produced of materials that are equal to or superior to those specified.



Erie Metal Specialties, Inc.
13311 Main Road
Akron, NY 14001
Phone: 716-542-3991
Fax: 716-542-3996
E-mail: sales@eriemetal.com
Web: www.eriemetal.com

- C. Any proposed alternate systems must be submitted and receive approval 21 days prior to the bid. All post bid submittals will not be considered. This submission shall be in accordance with MATERIALS AND SUBSTITUTIONS.

- Any manufacturer wishing to submit for prior approval must provide the following:

A working 6" sample of the proposed system with a letter describing how system is considered superior to the specified system.

A project proposal drawing that illustrates the recommended alternate system installed in the floor construction that is specific to the project. Typical catalog cut sections will not be considered.

A Verifiable list of prior installations showing prior and successful experience with the proposed Systems.

Any substitution products not adhering to all specification requirements within, will not be considered.

1.05 Quality Assurance

- A. Warranty: The Interior Floor Joint system's performance shall be warranted when installed by manufacturer's factory trained installer. Installation shall be in strict accordance with manufacturer's technical specifications, details, installation instructions and general procedures. Any variance of intended use excessive loading of the joint system will void the warranty.
- B. Manufacturer: Shall have a minimum ten (10) years experience specializing in the design and manufacture of Architectural Expansion Control Systems.
- C. Installation: The specified seismic system shall be installed by a factory trained installer approved to install the expansion joint system and fire barrier as required.
- D. Maintenance: The manufacturer shall provide the owner a preventive maintenance guideline for architectural expansion joint Systems.

PART 2 - PRODUCT

2.01 General

- A. Provide a floor joint cover expansion joint system that can accommodate multi-directional seismic movement without stress to its components. The system shall consist of metal profiles that utilize various finishes with a universal aluminum base member.
- B The cover plate shall be sized to such a width and thickness necessary to satisfy the project movement and loading requirements. Secure cover plate to base members by utilizing manufacturer's self-centering bar. Anchor the joint cover system to the floor slab adjustable the provided clip angles and the manufacturer's standard anchors.
- C Furnish EMS, Inc., model "ESFP" inverted joint cover, meeting ADA Guidelines for interior joint



Erie Metal Specialties, Inc.
13311 Main Road
Akron, NY 14001
Phone: 716-542-3991
Fax: 716-542-3996
E-mail: sales@eriemetal.com
Web: www.eriemetal.com

Systems as manufactured by Erie Metal Specialties, Inc. as indicated on the drawings.

2.02 Components and Materials

- A. Aluminum Extrusions - Material to conform to properties of ASTM B221, alloy 6061-T6 or 6063-T5.
- B. Aluminum Shapes - Material to conform to ASTM B209, alloy 6061-T6, or 5005-H34.
- C. Slide Plate - Provide minimum 3/16" thick plate with material to be aluminum conforming to ASTM B209, alloy 6061-T6, where loading requirements do not dictate a structural alloy, utilize 5005-H34 for slide plate installed in a floor to wall condition. Slide plate to be secured to joint assembly utilizing the self-centering bar that freely rotates in all directions. During seismic movement and full closure of the structural opening, the slide plate shall be capable of clearing the raised edge of the base member.
- D. Seismic-Centering Bar - Shall circular sphered ends that lock and slide inside the corresponding aluminum extrusion cavity to allow freedom of movement and flexure in all directions including vertical displacement. Bar shall be molded or manufactured incorporating corrosion resistant nylon components with sphered ends and 1" wide standard cross member for standard applications. Provide 1 1/2" wide cross member where heavy-duty application is required. Spacing shall be a maximum of 18" o.c.

During seismic activity design centering bar to permit vertical displacement of metal cover during inward and outward movement without evidence of fatigue and permanent deformation. Concurrently provide secure connection between plate and system components.

Bar shall exhibit the following physical properties to demonstrate ability to resist corrosion and fatigue.

PHYSICAL PROPERTIES

Molded End Profile:

Material:	Nylon
Color:	Black
Tensile Strength @ break:	ASTM D638 25,500 psi

Cross-Member:

Material:	Pre-tempered spring steel
-----------	---------------------------

Damage Mitigation - Test Requirements:

Seismic-centering bar must exhibit ability to disengage (controlled release) from expansion joint edge member(s) when seismic movement exceeds the specified maximum allowable opening.



Erie Metal Specialties, Inc.
13311 Main Road
Akron, NY 14001
Phone: 716-542-3991
Fax: 716-542-3996
E-mail: sales@eriemetal.com
Web: www.eriemetal.com

Requirements

- | | |
|--------------------------------|--|
| a) Equipment: | Instron Machine |
| b) Orientation: | Specimen subjected to tensile load with cross member parallel to direction of load |
| c) Specimens: | Test 4(min) – select at random |
| d) Disengagement range (lbs) : | 800 (min.) – 1250 (max.) |
- E. Moisture Barrier - Shall be a fabric reinforced tear resistant clean vinyl sheet material. Minimum thickness shall be .026".
- B. Anchorage - Provide minimum 1/4" diameter concrete expansion anchor at maximum 24" o.c. spacing to secure aluminum base member to floor slab.
- C. Block out Repair - Utilize a rapid strength repair mortar.
- H. Block out Infill - Utilize non-catalyzed, non-shrink grout containing aggregate.
- I. Accessories - Provide necessary and related parts, and fasteners required for complete installation.
- J. Fire Barrier Assembly - Designed for indicated or required dynamic structural movement without material degradation or fatigue. Tested in maximum joint width conditions with a field splice as a component of the expansion joint cover in accordance with ASTM E-119 at full rated period by a nationally recognized testing and inspecting organization. Supply Fire Barrier as governed by joint opening and fire rating.

2.03 Fabrication

- A. Extrusions and generic profiles to be shipped in standard 10 ft. lengths and shall be cut to length on jobsite where required. Profiles shall be miter cut in the field to conform to directional changes unless otherwise contracted with expansion joint manufacturer.
- B. Fire Barriers, ship manufacturer's standard assembly including fire caulks, sealants (if applicable) and hardware for the required hourly rating. Assemblies shall be miter cut in the field to accommodate changes in direction.

2.04 Finishes (Standard)

- A. The cover plate's exposed surface shall receive a 60-grit brushed finish. All other aluminum extrusions and shapes shall be supplied in standard mill finish.
- B. Surfaces of aluminum profiles that will be in direct contact with concrete where moisture is present shall receive one coat of manufacturer's recommended coating.



Erie Metal Specialties, Inc.
13311 Main Road
Akron, NY 14001
Phone: 716-542-3991
Fax: 716-542-3996
E-mail: sales@eriametal.com
Web: www.eriametal.com

- C. Finishes (optional) - Manufacturer shall utilize common aluminum alloys between system components to achieve consistency in product finish.
 - 1. Aluminum - (clear anodize)
 - Clear anodized finish in accordance with AA-M10 C22 A41 Class I (0.7 - 1.0 thick anodic coating).
 - 2. Aluminum - (color anodize)
 - Color Choice with matte or bright finish. Select from manufacturers standard color offering.


PART 3 - EXECUTION

3.01 Installation

- A. Install expansion joint systems utilizing manufacturer's block out repair and infill material(s).
- B. Protect all expansion joint component parts from damage during installation, placement of concrete and thereafter until completion of structure.
- C. Expansion joint systems shall be installed in strict accordance with the manufacturer's typical details and instructions along with the advice of their qualified representative.
- D. Expansion joint systems shall be set to the proper width for the ambient temperature at the time of installation. This information is indicated in the contract plans.

3.02 Clean and Protect

- A. Protect system and its components during construction. After work is complete in adjacent areas clean exposed surfaces with a suitable cleaner that will not harm or attack the finish.

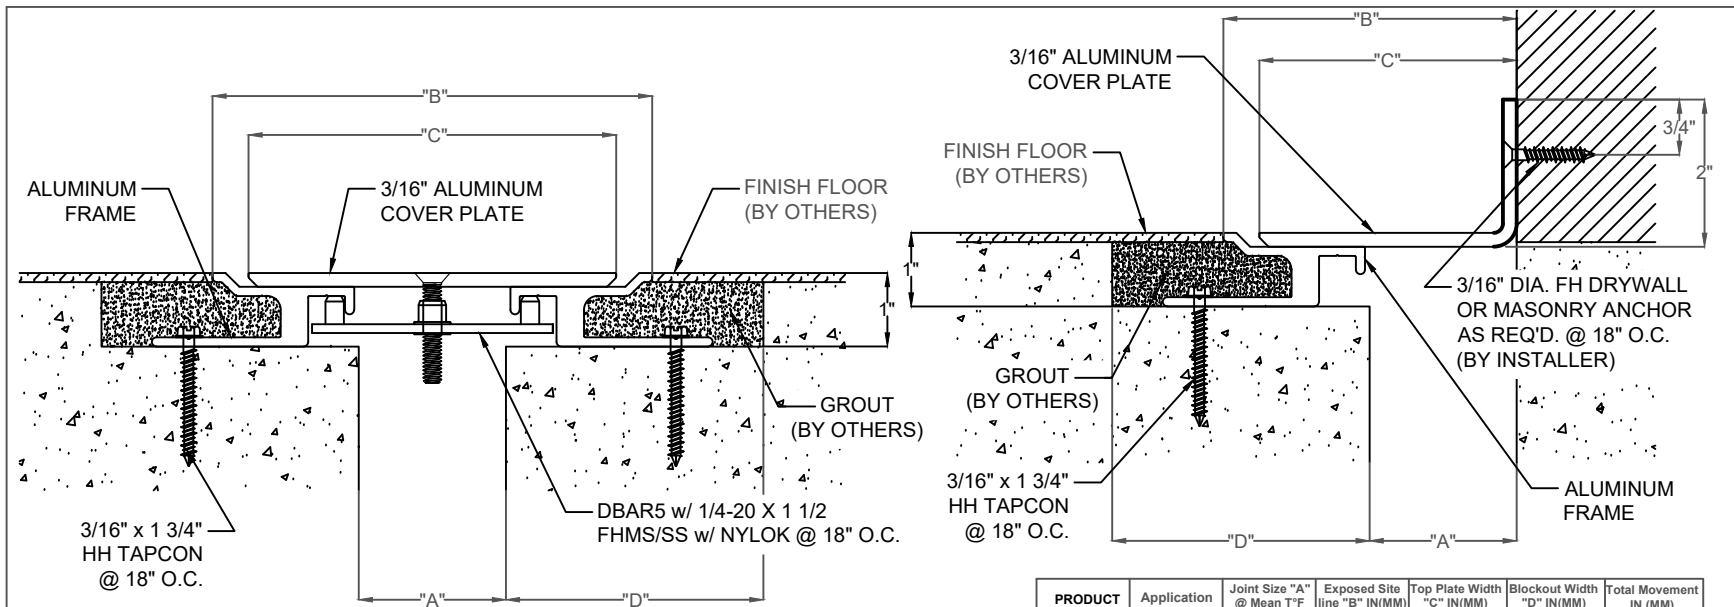

FLOOR TO FLOOR/WALL NO BUMP COVER

EXPOSED FINISH: MILL

MOVEMENT: +/- 50% NOMINAL JOINT WIDTH (floor-floor)

+/- 25% NOMINAL JOINT WIDTH (floor-wall)

STOCK LENGTHS: 10'-0"

PRODUCT	Application	Joint Size "A" @ Mean T°F	Exposed Site line "B" IN(MM)	Top Plate Width "C" IN(MM)	Blockout Width "D" IN(MM)	Total Movement IN (MM)
ESFP-200	Floor-Floor	2.00" (51)	6.00" (152)	5.00" (127)	3.50" (89)	2.00" (51)
ESFP-400	Floor-Floor	4.00" (102)	8.00" (203)	7.00" (178)	3.50" (89)	4.00" (102)
ESFP-600	Floor-Floor	6.00" (152)	10.87" (276)	9.875" (251)	4.00" (102)	6.00" (152)
ESFP-800	Floor-Floor	8.00" (203)	15.50" (394)	14.375" (365)	5.25" (133)	8.00" (203)
ESFP-1000	Floor-Floor	10.00" (254)	18.50" (470)	17.375" (441)	5.75" (146)	10.00" (254)
ESFP-1200	Floor-Floor	12.00" (305)	21.50" (546)	20.375" (518)	6.25" (159)	12.00" (305)
ESFP-200W	Floor-Wall	2.00" (51)	4.00" (102)	3.50" (89)	3.50" (89)	1.00" (25)
ESFP-400W	Floor-Wall	4.00" (102)	6.00" (152)	5.50" (140)	3.50" (89)	2.00" (51)
ESFP-600W	Floor-Wall	6.00" (152)	8.43" (214)	7.938" (202)	4.00" (102)	3.00" (76)
ESFP-800W	Floor-Wall	8.00" (203)	11.75" (298)	11.188" (284)	5.25" (133)	4.00" (102)
ESFP-1000W	Floor-Wall	10.00" (254)	14.25" (362)	13.688" (348)	5.75" (146)	5.00" (127)
ESFP-1200W	Floor-Wall	12.00" (305)	16.75" (425)	16.188" (411)	6.25" (159)	6.00" (152)

NO.	Description	Date	By
The information contained herein is the proprietary property of ERIE METAL SPECIALTIES, INC. No portion of it may be reproduced by any means or used in any form except for the purpose for which it was intended. All rights of design and invention are hereby reserved.			



13311 Main Road * Akron * New York * 14001
Phone: (716) 542-3991 * Fax: (716) 542-3996 * E-mail: sales@eriemetal.com

PROJECT:

TITLE: ESFP-200/200W - 1200/1200W

Detailed by:	Date:
BAF	10/21/17
Checked by:	Date:
SLP	10/21/17
Scale:	EMS Job #:
NTS	
Sheet No.:	Drawing No.:
1 of 1	ESFP-1